

# DEALING WITH PROBLEMS IN OUTPUT RELAYS USED IN MICROPROCESSOR-BASED PROTECTION DEVICES - PART I

By Gurevich Vladimir, Ph.D., Professor, Israel Electric Corp., Central Electric Laboratory

It is the second publication of the author about nonconformance of parameters of subminiature output relays used in microprocessor-based protective devices to actual operation conditions and standards. This article suggests modifications of standards and also reveals concrete technical recommendation for solution to this problem.

## INTRODUCTION

Conversion from electromechanical and static to microprocessor-based protection devices (MPD) is frequently accompanied by a number of technical problems, usually unknown to the consumer. One of these problems is nonconformance of subminiature electromechanical relays (SER), used as output elements of MPD, to the parameters specified in the MPD data sheet, actual standards, and real operation conditions. After the publication of the results of this research,

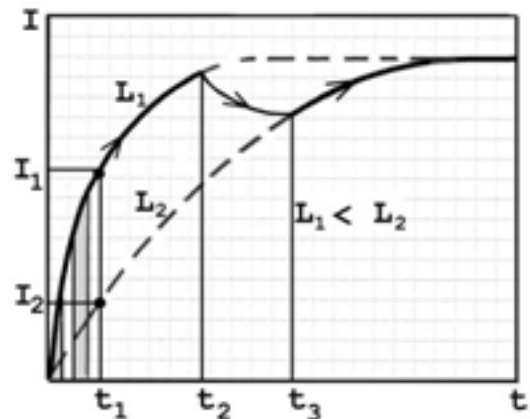


Fig.1. Dependence of current (I); (L) is load.

I1 – current breaking at low inductance of load; I2 – current breaking at high inductance of load; t1 – bouncing period; t2 – start moving of core in trip solenoid; t3 – stop moving of core in trip solenoid

THE COLT GROUP

EXPERTS IN  
TRANSFORMER LEAK REPAIR

<ul style="list-style-type: none"> <li>Flapper Valve Packing</li> <li>Flapper Valve Flanges</li> <li>Tap Changers</li> <li>Pumps</li> <li>Drain Plugs</li> <li>Cover Plugs</li> <li>Bushings</li> <li>Weld Leaks</li> </ul>	<ul style="list-style-type: none"> <li>Two Year Guarantee</li> <li>No Draining Oil</li> <li>Sealant</li> <li>Compatibility Analysis</li> <li>Dialectrically Tested Sealant</li> <li>Experienced Technicians</li> <li>Lump-Sum Quotes</li> <li>Reduced Down Time</li> </ul>
---	--

866-572-5325

OIL LEAK REPAIR SERVICES

www.coltonline.com

the author discovered an earlier publication in which experts from Vector Power Solutions Ltd, General Electric and National Grid Transco also noticed these discrepancies. In addition, the author has received responses to his article from experts of SER Manufacturers, from the Technical Committee 94 (All-or-nothing electric relays) of the IEC; and from other specialists. Thus, we can assume that the existence of this problem is confirmed and recognized by the international engineering public.

The purpose of this publication is to research ways of solving this problem.

## NONCONFORMANCE PARAMETERS OF MPD OUTPUT CONTACTS TO PARAMETERS OF SER

As MPDs are devices that work only in emergency modes, the frequency of their operation and total number of operations for all service life are very insignificant (we shall show, 103 operations) in comparison with the normal number of the operations allowable for SER (105 – 106). As erosion of contacts at switching has a cumulative character, it is abundantly clear that SER manufacturers set limitations on the switching ability of contacts, proceeding from what is accepted as usual for them (that is a large number of operations). It is, therefore, possible to expect that for a number of operations 100 – 1000 times less than what is usually accepted for SER, (the top rod)

Subminiature Electro-magnetic Relay Type	Maximal Switching Power (for resistive load)		Rated Current & Voltage (for resistive load)		Make Current for Inductive Load (L/R) In Mode with Very Infrequent Making Cycles (1000)			
	AC	DC	AC	DC	125 VDC		250 VDC	
					10 ms	25 ms	10 ms	25 ms
	ST	2000 VA	150 W	8 A; 380 V	5 A; 30 V	?	?	?
JS	2000 VA	192 W	8 A; 250 V	8 A; 24 V				
RT2	2000 VA	240 W	8A; 250 V	8A; 30 V				
RYII	2000 VA	224 W	8A; 240 V	8A; 28 V				
G6RN	2000 VA	150 W	8 A; 250 V	5 A; 30 V				
G2RL-IE	3000 VA	288 W	12 A; 250 V	12 A; 24 V				

Table 1. Switching capability of subminiature electromechanical relays using in MPD

in limitations on their switching ability can be essentially increased.

An especially heavy mode for SER contacts, it is considered a mode of switching of inductive loads at DC voltages as high as 125V and 250V (standard voltages of a DC system on substations and power stations). According to the data sheet on SER, used today in MPD, none of them can be used for work in such conditions. This limitation is absolutely correct in the formal view and completely supported by manufacturers. However, when taking this question into consideration, it is necessary to take into account that “switching” for SER must be understood as a “full cycle”, that is both part of the “switching” cycle inclusive: and making and breaking of a circuit. Actually, in the full cycle mode while in MPD it works only the contacts of the internal SER which is intended for control of other (outside) auxiliary relays.

The most powerful MPD contacts are intended only for turning-on (making) without breaking the trip coil of the high-voltage circuit breaker (CB). Disconnection (break) of the trip coil circuit from the DC power supply is carried out by their own powerful auxiliary contacts of the CB. Hypothetically only, making of contacts does not affect the electric arc between the contacts and, consequently, there should not be any special limitations for turn-on of inductive load at a DC voltage of 125 – 250 V. The problem appears because the actual contact making process is accompanied by repeated impacts (making) and bounces (breaking) of contacts. In other words, there is no “pure” turn-on without turn-off – it simply does not exist. Even single breaking as mentioned above (an inductive load of 10 – 15 A at DC voltage 125 – 250 V), will produce a high energy electrical arc between SER contacts which may weld them together. In addition, at enlarging of load inductance, the more energy exuded on contacts increases the probability of welding. For this reason, the DC switching capability specified in the data sheet on SER for active load at voltages up to 30V only, may not even close them to required values. This is also the reason that there are not any separations between various kinds of switching modes because of the danger of even single switching-off with a powerful arc on contacts. It is interesting that this approach is accepted not only by SER manufacturers, but also by the corresponding committee on standardization at the IEC.

However, more detailed consideration of this problem, it

would appear that this situation is not so un-equivocal, and more likely paradoxical, because at turn-on of the inductive load by relay contacts, the current through the contacts increases smoothly. Increasing inductance causes the current to increase more slowly. At the same time, contact bouncing with impact occurs only at the initial stage of the making process, prolonging a very limited time period, usually not exceeding 3 – 4 ms for subminiature relays and not dependent on load inductance. This brings about a paradoxical situation:

## MIDAS Metering Services Ltd.

**MIDAS provides customers with corporate-wide access to business-critical electrical energy information services.**

*“Putting the power of information in your hands.”*

710, 138 - 4th Avenue S.E., Calgary, AB Canada T2G 4Z6  
 Telephone: (403) 301-3314 Facsimile: (403) 301-3316  
[www.midasmetering.com](http://www.midasmetering.com)

Utilization Category	Type of current	Switching capacity of contacts in the mode of normal switching					
		Make (switching ON)			Break (switching OFF)		
		current	voltage	cosφ	current	voltage	cosφ
IEC 60947-4							
AC-15	AC	10 I <sub>N</sub>	U <sub>N</sub>	0.3	10 I <sub>N</sub>	U <sub>N</sub>	0.3
DC-13	DC	I <sub>N</sub>	U <sub>N</sub>	-	I <sub>N</sub>	U <sub>N</sub>	-
Switching capacity of contacts in the mode of infrequent switching							
AC-15	AC	10 I <sub>N</sub>	1.1 U <sub>N</sub>	0.3	10 I <sub>N</sub>	1.1 U <sub>N</sub>	0.3
DC-13	DC	1.1 I <sub>N</sub>	1.1 U <sub>N</sub>	-	1.1 I <sub>N</sub>	1.1 U <sub>N</sub>	-
Switching capacity of contacts for 1000 making cycles							
DC-13	DC	?	?	U <sub>R</sub> ≤10 ms	-	-	-
	DC	?	?	U <sub>R</sub> ≤20 ms	-	-	-
	DC	?	?	U <sub>R</sub> ≤40 ms	-	-	-

Table 2. Switching capacity of contacts depending on the type of load for control electromagnets, valves and solenoid actuators  
I<sub>N</sub> and U<sub>N</sub> rated values of currents and voltages of electric loads switched by relay contacts

the more inductance of load, the less the value of current that is broken off by contact bouncing during the making process (fig. 1). This means that the standard reasoning stated above in that specific situation is not relevant and the real capacity of the SER contacts making an inductive load which may be much higher.

Because MPD are very important and crucial devices which determine working ability of a major sector of the economy, urgent research for functioning SER contacts in this spe-

cific mode is necessary. On the basis of this research SER companies/manufacturers should add technical specifications to relays in a mode of very infrequent making of inductive loads at DC voltages of 125 and 250V (tab. 1). If, besides bringing MPD manufacturers to audit technical specifications and eliminate obvious mistakes regarding switching capability of the output relay contacts described here, there can be a difference between the parameters written in the specifications of MPD and SER (albeit not that much).

#### NONCONFORMANCE TO ACTUAL STANDARDS IN MPD OUTPUT CONTACT PARAMETERS

Some standards are considered as universal, for example IEC 60947-4, and also the new 3 edition of IEC standard 61810-1 (presently applied at the stage of consideration) the relay contacts switching capability (in category DC-13), when corresponding to a certain mode, consider separate make and break inductive loads. According to these standards the switching capability of these contacts for make and for break is identical and equals 100% of rated current in a mode of normal switching, and 110% in a mode of infrequent switching. Such ratios obviously specify that at their definition the phenomenon of bouncing contacts and probability of circuit breaks with an inductive load at a full current were taken into account. That is, without taking into account the conclusions formulated earlier. In a concrete considered mode, it is possible to allow considerably higher currents at make contacts. In our opinion, these standards should be edited by adding, in view of the above-mentioned reasons, a special switching mode, used in MPD (table 2).

#### IMPROVEMENT OF MPD BY MANUFACTURERS

Carrying out of all the necessary stages of SER testing in the specified mode, entering corrections into the technical documentation, and especially correction of standards, is a long enough process which can take years. During this time, the problem may be solved by MPD manufacturers independently, with no connection to this process. We shall consider probable ways for solving this problem.

Use of compact relays intended specially for switching inductive load at 125 – 250V DC. For such ability the contact system of the relays incorporated a blow-out magnet, placed

**VERIFY YOUR TRANSFORMER  
CONDITION WITH FREQUENCY  
RESPONSE ANALYSIS**

**PHENIX TECHNOLOGIES**  
ISO 9001 CERTIFIED

**Phenix Technologies  
offers the Model FRA-100**



- PC Based analysis
- Fast—Test can be performed in approximately 30 minutes
- Detects changes in winding structure
- Does not require historical data for analysis
- Provide an Objective Winding Analysis on 3-phase transformers
- Measures in higher frequency ranges to increase sensitivity
- Lightweight and compact

We also offer:

- AC and DC Hipots
- Megohmmeters
- Insulation Analyzers
- Portable High Current Testers
- Circuit Breaker Test Systems
- Recloser Test Systems
- Motor and Transformer Test Systems
- And much more!

**Contact  
Phenix  
Technologies  
with your  
testing  
requirements**

116 Industrial Drive • Accident, Maryland 21520 U.S.A.  
Phone (301) 746-8118 • Fax (301) 895-5570  
[www.phenixtech.com](http://www.phenixtech.com)

High Voltage  
High Current  
High Power  
Test Systems  
and Components

between contacts. Magnetic field of the magnet interacts with DC arc between contacts and rapidly repulsing it away from the contacts at their breaking. Many companies produce such relays today, (fig. 2). Some of them are suitable for installation on the printed-circuit-board (PCB). For example, the JC2aF-H73 produced by Matsushita, IG2C-24VDCM, produced by Kuhnke, etc. Application of such relays can appear effective not only for making of the CB trip coils used in usual schemes, in view of what was stated above, but much more for making of these coils in special schemes with the forcing capacitor which creates a high current pulse through the coil (and contacts, of course) in the initial stage of the making process for it acceleration, fig.3. For this specific but widely used scheme, the reasoning regarding small current value is that breaking by contacts at bouncing in the initial stage of the process is not so relevant, therefore use of such relays may be very effective.

For wider usage, it is desirable to have thyristors for currents of 30 – 70A

Thyristor type		BTW 69- 1200	40TPS 12	CS 60- 160I CS 60- 140I CS 60- 120I	70TPS16 70TPS12
Max. repetitive off-state peak voltage, V	$V_{DRM}$ $V_{RRM}$	1200	1200	1600 1400 1200	1600 1200
Max. on-state rms current, A	$I_{T(RMS)}$	50	55	75	75
Peak, _ cycle (sine) non repetitive surge current, A	$I_{TSM}$	580	500	1500	1200
Max. peak forward on-state voltage (voltage drop), V	$V_{TM}$	1.9	1.85	1.4	1.4
Max. holding current, mA	$I_H$	150	150	200	200

Table 3. Parameters of some modern thyristors, suitable for using as output elements of MPD

and voltages of 1200 – 1600V, complete with varistors, as the powerful output contact of MPD which is intended only for making (without breaking) the trip coil of the circuit breaker. Modern thyristors with such parameters (tab. 3), have small sizes (fig. 4), and in view of the short duration of current passing through them, can be used without Heatsink.

Thyristors should be chosen with a

hold current of not less than 50 – 70 mA and they should not remain in the conductive condition under action of small-current so-called “supervision relays”. There should be a supervising serviceability of all trip circuits by means of having a small current passing through it (approx. 15 – 20 mA). Thyristors have

Continued on page 49



PowerTech Labs Inc. is a multi-disciplinary technology centre with R&D, testing and consulting in:

- electrical
- metals and material
- chemical
- civil
- mechanical
- environmental
- alternative energy

[www.powertechlabs.com](http://www.powertechlabs.com)

ISO 9001 Registered

## POWERTECH LABS INC.

### Insulating Fluid Analysis and Advanced Diagnostics Training

Powertech offers a 4-day training course on “Insulating Fluid Analysis and Advanced Diagnostics”. We have combined our extensive experience and knowledge into an easy to understand package.

#### Date of course

- April 23 to 26, July 16 to 19, Oct 22 to 25

#### Who should take this course

- Laboratory chemists and analysts
- Substation maintenance personnel and engineers

#### Benefits of the course

- Use correct sampling procedures to ensure receiving proper results

- Interpret test result and use them for diagnostic purposes
- Set up a testing program for maintenance to save time and money

#### Course modules

- Insulating Oil Fundamentals
- Oil Sampling Fundamentals
- Oil Quality Analysis
- Gas in Oil Analysis
- Paper Insulation Analysis
- Equipment Test and Sampling Program
- SF<sub>6</sub> Gas Fundamentals
- SF<sub>6</sub> Sampling and Analysis

For more information please visit [www.powertechlabs.com/ifaad](http://www.powertechlabs.com/ifaad)

**Powertech**   
A subsidiary of BC Hydro

A07-027

## Your source for the latest – and most valuable – knowledge on electric power apparatus performance



- Network with hundreds of utility and testing company colleagues – learn from their experiences, and share your own
- 5 days of technical presentations and training sessions on subjects selected by Doble utility and testing company clients
- 5-hour intensive session on Corrosive Sulfur-a cause of failure in power transformers
- Tutorials:
  - “The Importance of Proper Bushing Replacement” (The industry standard has changed)
  - “Utility Compliance to NERC Standards”
- New Training Track provides expanded educational opportunities for entry-level engineers and technicians
- Newcomers can gain assistance from experienced Conference attendees with Doble’s new Mentor Program
- Learn what’s new in diagnostics with Doble products and services.

## The 2007 International Conference Of Doble Clients

**March 25 – 30, 2007**  
**Westin Copley Place Hotel**  
**Boston, MA, USA**

For more information and the complete Conference agenda, go to [www.doble.com](http://www.doble.com) or call **+1-617 -926-4900**

**TOGETHER WE POWER THE WORLD**



# BE THERE

Australia   China   India   Norway   South Africa   UK   United States

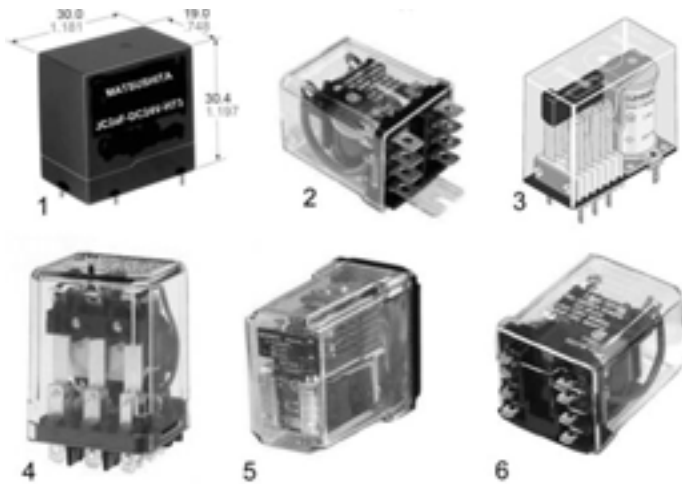


Fig. 2. Compact relays with blow-out magnets suitable for switching inductive load at 125-240 VDC.

1: JC2aF-DC24V-H73 type (Matsushita); 2: 300 series (Magnecraft); 3: IG2C-24VDCM type (Kuhnke); 4: KUEP-3D17-12 (Potter & Brumfield); 5: 219 series (Magnecraft); 6: A283 series (Magnecraft).

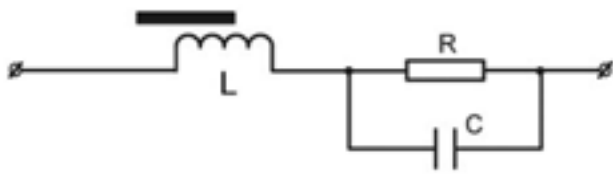


Fig. 3. A circuit diagram for forcing switching of the CB tripping coil (L).



Fig. 4. Modern thyristors for switching current 30 – 75 A at 1200 – 1600 V, made in a compact cases.

the best overcurrent and overvoltage capability in comparison with power transistors, IGBT, FET.

In perspective, the decision should be, in MPD, to use hybrid devices containing a SER contact and a solid state switching element, connected in parallel. One of these devices is suggested by the author in fig. 5.

In this device the control signal is put to a winding of the SER and simultaneously charges capacitor C, through a limit resistor (R1) and the gate circuit of thyristor VS. The thyristor instantly opens by means of this charging current (with a delay

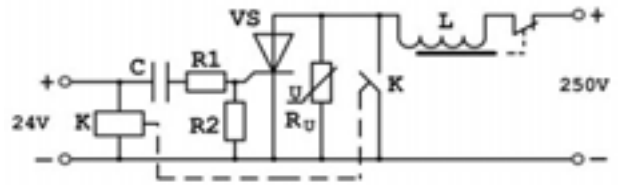


Fig. 5. Circuit diagram of hybrid element intended for energizing trip coil at 250 VDC.

of some microseconds) and picks-up the CB trip coil L. Contact K closes and shunts the thyristor through 7 – 10 ms (the own time of operation of the SER). The current of trip coil L flows to a circuit of contact K. At the beginning of this process there is an opening of contacts at bouncing, inter-contact resistance, and the voltage on the contacts starts increasing. This voltage is put to thyristor VS.

At an increase in this voltage of up to 5 – 7 V, the thyristor again instantly opens as this time the capacitor C has not yet been completely charged and charging current continues to flow through the gate of the thyristor. The capacity C and resistance R1 leave this condition in order to guarantee a thyristor gate current of about 50 – 70 mA during 15 – 20 ms, that is, before the full termination of contact bouncing. Thus, during the contact making process there is no break of the trip coil circuit and there is no arc on the contacts. After full charge of the capacitor, the current in the thyristor gate circuit stops, is finally locked and no longer influences the condition of the load (trip coil) circuit. At the disappearance of the control signal at the input of the device, the capacitor is discharged through the

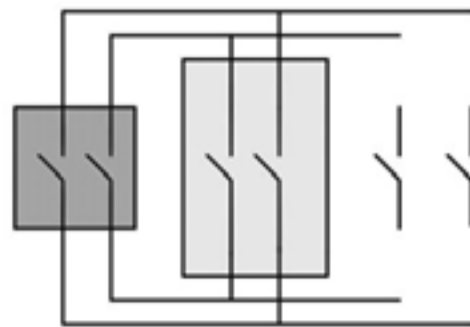


Fig. 6. Connection in parallel-in pairs contacts from the relay of various types for excluding of bouncing.

coil of the relay K.

As the basis of the problem of switching-on of the trip coil is the bouncing of contacts, accompanying short-term breaks of current during the making process, the natural solution of this problem could be to compensate these breakages with a combination of two contacts connected in parallel with the various parameters of vibration which are not conterminous on a phase (fig. 6).

It is abundantly clear that if connected in parallel in pairs, contacts of relays of various types, with various mechanical properties of contacts, we can predict confidently that it is possible to guarantee non-conformity in the phase of bouncing that is absent of breaks of circuit during the switching-on of induc-

tive load. MPD manufacturers can take their cue from this principle, using in their products usual SER as described above, and SER manufacturers can produce relays containing, in the single case, two contacts with different rigidities or weights, in which vibration at bouncing does not coincide on a phase, having connected both these contacts in parallel.

Power reed switches with increased switching capability have now appeared in the market (fig. 7) and the relays on which they are based could be used with success as output contacts in MPD.

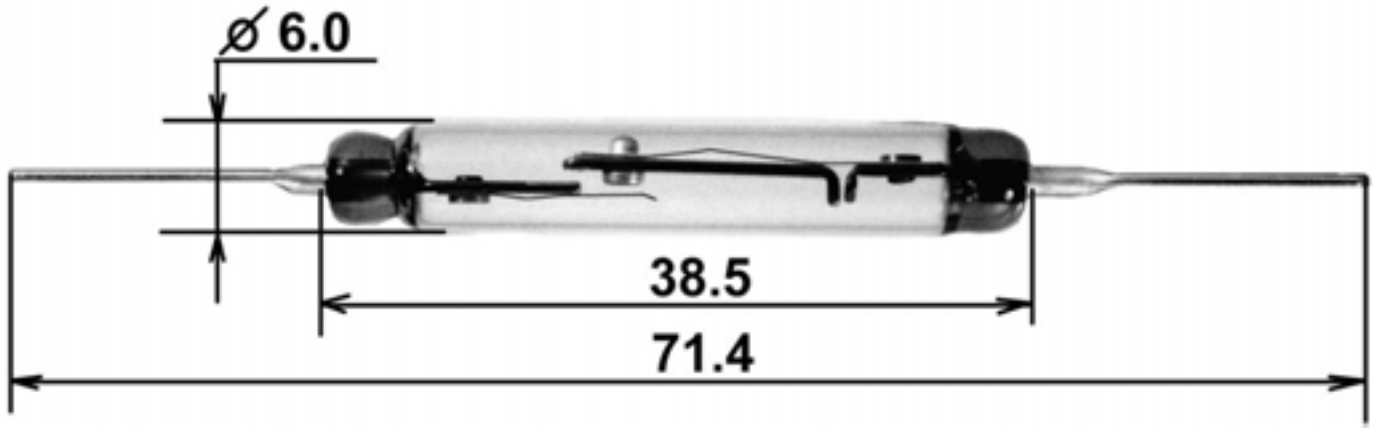


Fig. 7. Power reed switch R14U and R15U (Bestact, produced by Yaskawa) with two-stage contact system for switching inductive load.

Such reed switches with a rated current of 5 A are capable not only to make, but also to break circuits with inductive loads at 230V DC. For example, they are capable of switching-off 0.4 – 0.6 ADC with a constant time of 40 ms. That it is quite enough for their usage as the auxiliary contacts of MPD intended for control by external auxiliary relays. The operating time of these reed switches does not exceed 5 ms, bouncing time not more than 2 ms; switching cycles number 50 - 100 million. It is obvious that when reducing the requirement of the number of switching cycles 10,000 times, we should expect an additional increase in their switching current (that should be confirmed with the manufacturer, of course). When choosing auxiliary output relays for MPD, it is necessary to take into account that some of them will be used for switching of the coils of the external electromagnetic relays at 125 – 240 V DC, and some others for switching of low-voltage and low-current signals on logic inputs of other MPD. Usually that is not taken into account in any way by manufacturers of MPD, however, it is known that for switching powerful loads and for switching low-current, low-voltage signals, contacts should have different properties and should be made from different materials. This is reflected in the technical specifications on SER. For example, a relay with powerful contacts will have limits on the lower threshold of a switched current and voltage, and this threshold frequently lays within the values used in practice for small level control signals. Therefore, two types of SER corresponding to two types of loads should be used as auxiliary output relays in MPD, as mentioned above.

Modern high-voltage IGBT transistors can be successfully used as powerful output auxiliary relays of MPD. The small sizes (plastic case TO-247 and similar types), have high values of collector current, high withstanding overvoltages, high power dissipation, and high allowable working temperatures of the crystal (tab. 4), making such transistors rather attractive elements for switching inductive loads (coils of external auxiliary relays) with a consumption of 0.1–5 A at 250 VDC. For over-voltage protection when switching inductive loads, such transistors can also be protected by varistors with a clamping volt-

age of 500-700V. As is known, some problems may arise when using IGBT transistors represented by the correct organization of their control circuits, however, today these problems are successfully solved and there are numerous drivers for controls of IGBT transistors on the market which are made as small modules, fig. 8. In such drivers, all necessary element are contained inside for reliable switch-on and switch-off IGBT transistors.

Single modules of this type and two IGBT transistors, form analogs of high-quality changeover contacts, galvanically isolated from the internal control circuits of the MPD.

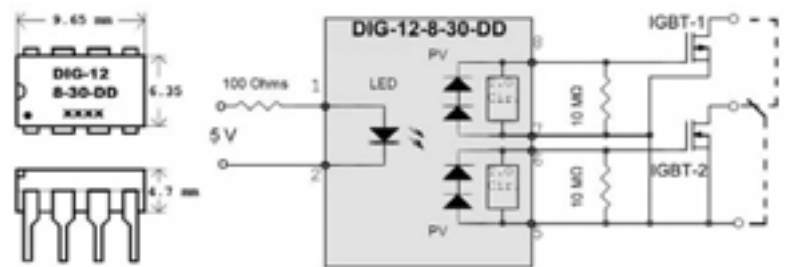


Fig. 8. Modern galvanic isolated driver for controls of pair IGBT transistors, formatives single changover contact.

**Look in the March issue for Part II of Dealing with Problems in Output Relays Used in Microprocessor-Based Protection Devices.**